


## 4. OTIS·LG

HIGEN

4 - 2)

(Discharge Inception Voltage)



System Surge

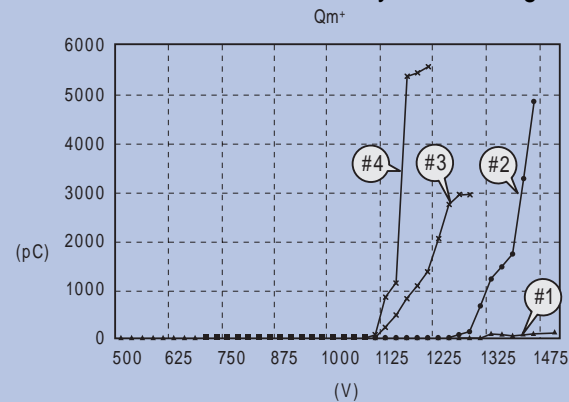

No.	#1	#2	#3	#4
	OTIS LG	System Type「A」	System Type「B」	System Type「C」
DIV(10pC )	1200V	1150V	1075V	1075V

1. DIV (Discharge Inception Voltage) :
2. Surge : 750V ( Dresden University )  
850V ( )
3. Data

( : #1 #2 , #1 가 )

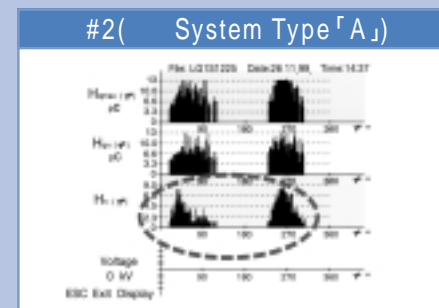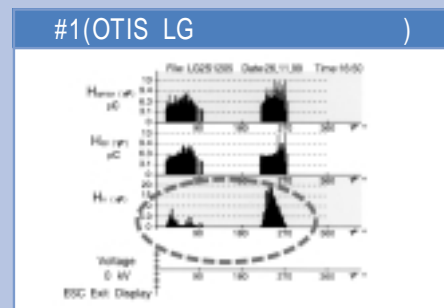

OTIS·LG